


RAW SEWAGE LIFTING SUMP SMP-101	SCUM COLLECTION SUMP S,P-202	RAW SEWAGE PUMP PMP-102	COMMINUTOR COM - 103	SCREENING CHAMBER BSC-104	AERATION TANK TNK-201	SETTLING TANK TNK-301	SCRUBBER SCR-302	CHLORINE CONTACT TANK TNK-501	TREATED WATER PUMP PMP-402
------------------------------------	---------------------------------	----------------------------	-------------------------	------------------------------	--------------------------	--------------------------	---------------------	----------------------------------	-------------------------------

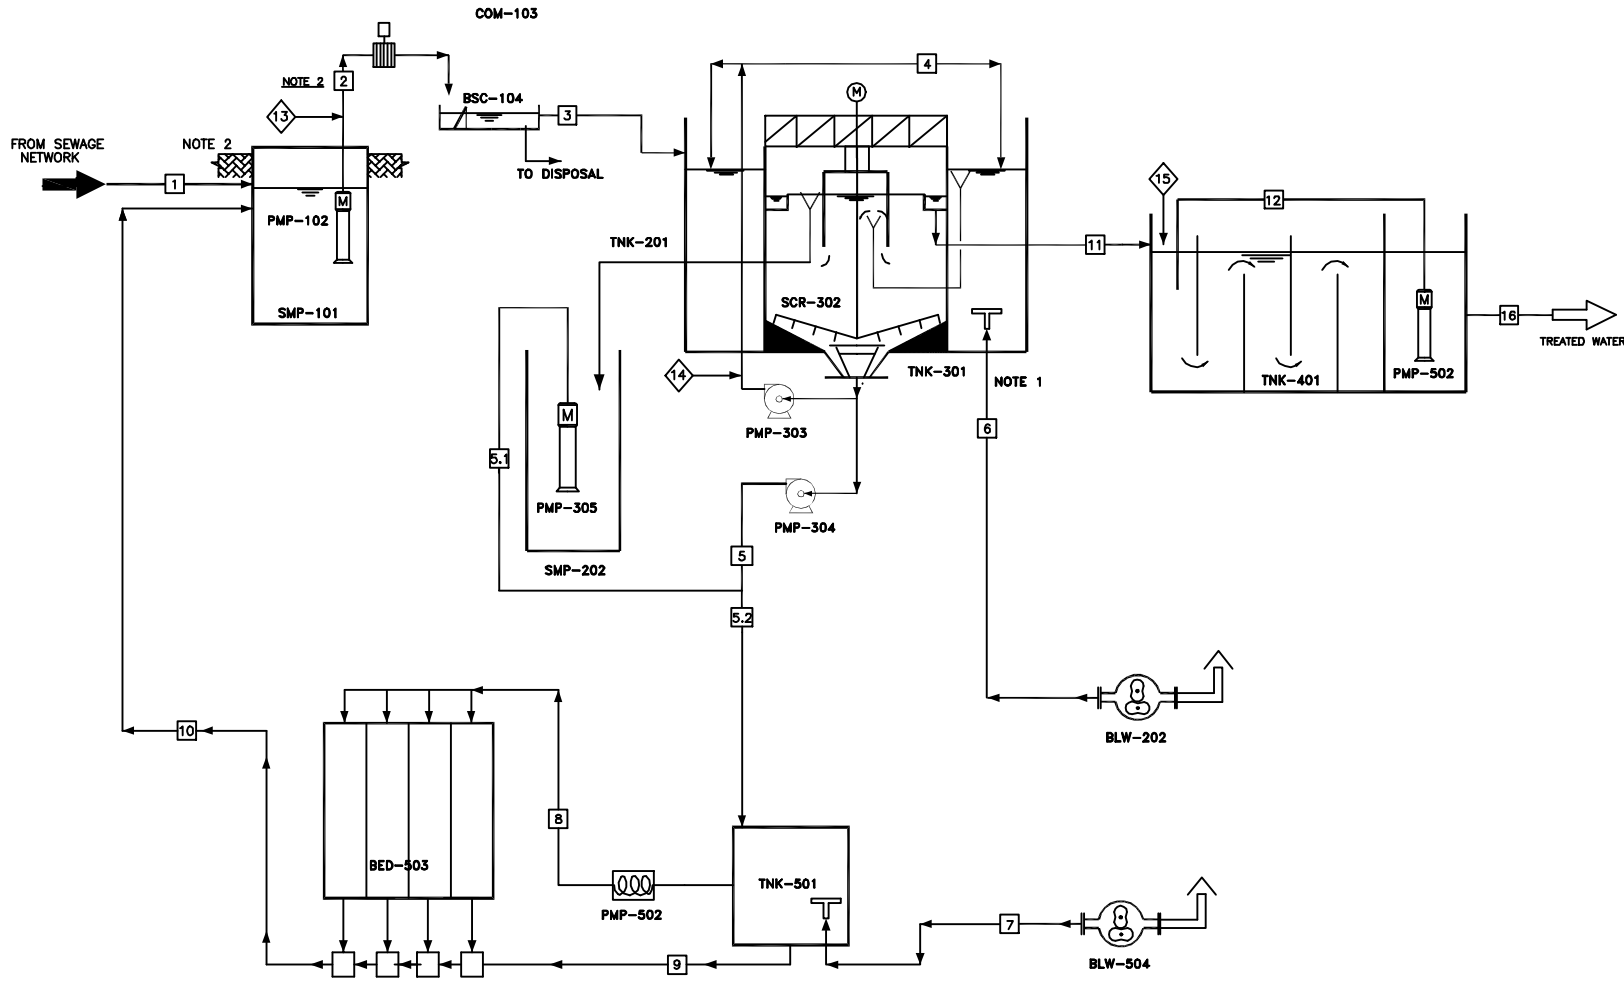

SCUM PUMP PMP-305	AERATION TANK AIR BLOWER BLW-202	RETURN SLUDGE PUMP PMP-303	EXCESS SLUDGE PUMP PMP-304	DIGESTOR TNK-501	DIGESTOR TANK AIR BLOWER BLW-504	DRYING BEDS PUMP PMP-403	DRYING BED BED-404
----------------------	-------------------------------------	-------------------------------	-------------------------------	---------------------	-------------------------------------	-----------------------------	-----------------------

STREAM	1	2	3	4	5	5.1	5.2	6	7	8	9	10	11	12	13	14	15	16	
NAME	RAW SEWAGE	RAW SEWAGE	RAW SEWAGE	RETURN SLUDGE	EXCESS SLUDGE	SCUM	EXCESS SLUDGE	AIR	AIR	SLUDGE	SUPER-NATANT	SUPER-NATANT	CLARIFIED WATER	TREATED WATER	CHLORINE	CHLORINE	CHLORINE	TREATED WATER	
FLOW m <sup>3</sup> /hr	MAX. FLOW	194	194	194	45.5	45.5	6.8	52.3	2366	2366	45.5	--	--	194	23	0.064	0.064	0.064	194
	NORMAL FLOW	38.8	38.8	38.8	45.5	45.5	6.8	45.5	2366	1183	45.5	--	--	38.8	23	0.064	0.064	0.064	38.8
PRESSURE MT.WC	--	17	15	8.5	8.5	20.5	8.5/20.5	5.5	5.5	35	--	--	--	30	40	40	40	--	